
SUMMER WORK CONDITIONS

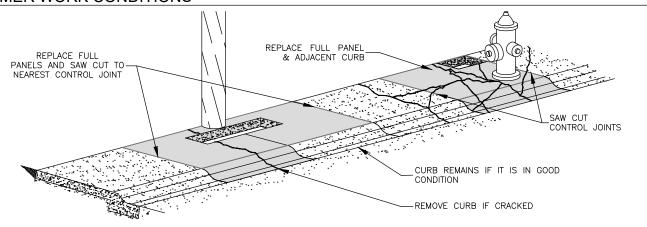

RESTORATION PROCEDURE

CUTTING AND REMOVAL OF CONCRETE


- 1. REMOVE CONCRETE PANELS AND CURB LENGTHS TO THE NEAREST CONTROL JOINT THAT IS DISTURBED BY A UTILITY CUT, INCLUDING PANELS OR CURBS UNDERMINED DUE TO THE CUT.
- 2. FOR UTILITY CUTS IN MONOLITHIC SIDEWALKS, REMOVE THE CURB WITH THE SIDEWALK, UNLESS THE CURB IS IN GOOD CONDITION (NO CRACKS).
- 3. BEFORE REMOVAL, SAW CUT THE CONCRETE THROUGH ITS FULL DEPTH, LEAVING A STRAIGHT VERTICAL FACE. CONCRETE MAY BE BROKEN AT CONTROL JOINTS WITHOUT SAW CUTTING PROVIDED A STRAIGHT VERTICAL FACE FREE OF LOOSE MATERIALS REMAINS.

RECONSTRUCTION OF THE CONCRETE

1. CONSTRUCT REPLACEMENT CONCRETE IN ACCORDANCE WITH DRAWINGS:

00-03-01	00-03-03	00-03-05	00-03-07
00-03-02	00-03-04	00-03-06	00-03-08

WINTER WORK CONDITIONS

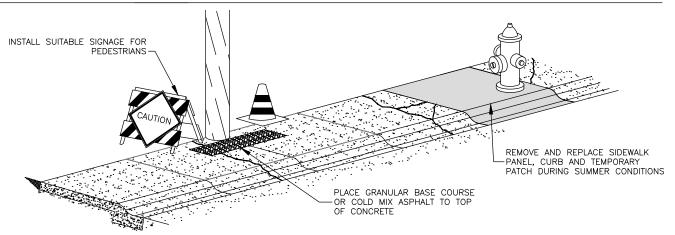

RESTORATION PROCEDURE

- AFTER COMPLETING THE UTILITY WORK, FILL THE CUT WITH COLD MIX ASPHALT OR GRANULAR BASE COURSE PLACED IN 150MM LIFTS (MAXIMUM), COMPACTED TO 95% OF STANDARD PROCTOR DENSITY UP TO THE TOP OF CONCRETE.
- 2. THE COMPANY WILL INSTALL SUITABLE VISIBLE SIGNAGE TO INDICATE HAZARD FOR PEDESTRIANS. THE COMPANY WILL MAINTAIN THE SIGNAGE OVER THE WINTER CONDITIONS.
- 3. IN SUMMER CONDITIONS PROCEED WITH THE CONCRETE REPAIRS.

GENERAL NOTES

- 1. ALL BURIED UTILITY CUTS AND RESTORATIONS MUST BE REPORTED TO PUBLIC WORKS AND FOLLOW PROCEDURES AS PER MASTER SPECIFICATIONS 6100: BURIED UTILITIES.
- 2. MINIMUM CONCRETE THICKNESS IS 100mm, MINIMUM CONCRETE STRENGTH IS 32 MPa.
- 3. RELATED SECTIONS: CONCRETE SIDEWALKS, CURBS AND GUTTERS 02770

			CITY OF PRINCE ALBERT PUBLIC WORKS	11.1
			SHALLOW BURIED UTILITY REPAIR	
2	FEB 2020	REVISED SPECIFICATIONS	TYPICAL CONCRETE CUT SCALE N	N.T.S.
No.	DATE	REVISION	DRAWN R.REGNIER DESIGNED M.GAREAU DATE FEB 2020 DWG. No. 00-	-04-19